


Charlotte IOP Bootcamp Demonstration

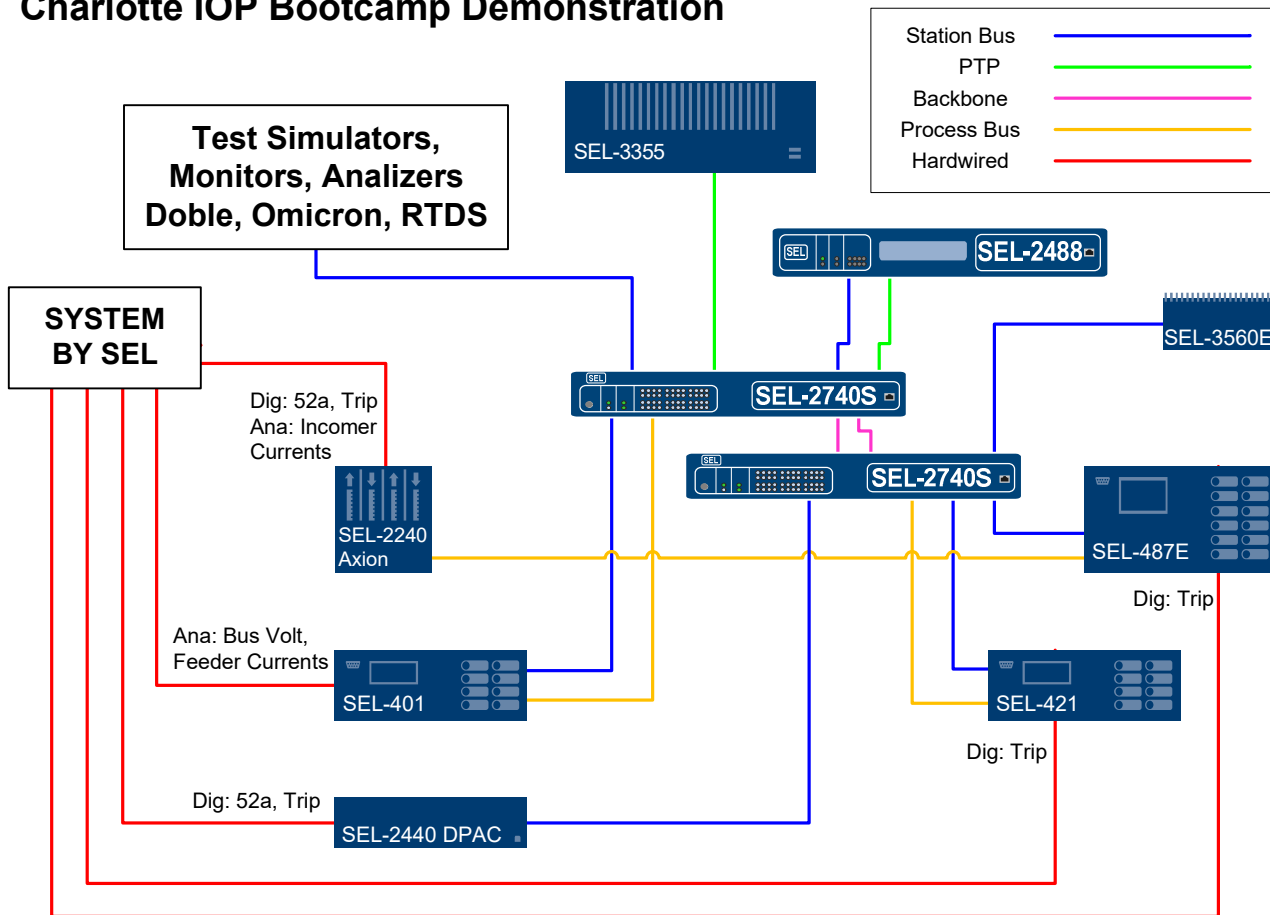

Device	IP Address	Dev Port	Switch	Station Port	Process Port
Controller	10.221.23.120		SDN1	D1	
SEL-2740S-1	10.221.23.121				
SEL-2740S-2	10.221.23.122				
SEL-3560E	10.221.23.123	Eth2	SDN2	E3	
SEL-401-MU	10.221.23.127	5B/5C	SDN1	E3	C1
SEL-2440	10.221.23.131	1A	SDN2	F3	
SEL-487E-T	10.221.23.132	5A	SDN2	F4	
SEL-421-REL	10.221.23.133	5B/5C	SDN2	E2	C1
SEL-2488	10.221.23.2	Eth1/Eth3**	SDN1	E4	F4
SEL Laptop	10.221.23.199		SDN1	E1	
DO NOT USE			SDN2	F1	
TEST SET	10.221.23.200	***	SDN2	E1	
** Doble directly connected to Eth2					